

PLAN NOTES

PN-1 PERFORM A COMPLETE DEMOLITION AND REMOVAL OF THE ELECTRICAL SYSTEMS WITHIN THE LIMITS OF THE GUTTED SPACE AS FOLLOWS:

A. LIGHTING SYSTEM:

- REMOVE ALL LIGHTING FIXTURES AND EXIT SIGNS INCLUDING BUT NOT LIMITED TO FIXTURE HOUSINGS, PLASTER FRAMES, DIFFUSERS, LENSES, LAMPS, FIXTURE SUPPORTS, ETC.
- REMOVE ALL OUTLET BOXES.
- SURVEY, TRACE, IDENTIFY AND REMOVE ALL BRANCH WIRING INCLUDING BUT NOT LIMITED TO CONDUCTORS, CONDUIT, OUTLET BOXES, JUNCTION AND PULL BOXES, SUPPORTS, ETC.
- PROVIDE TEMPORARY POWER AND REFEED EXISTING LIGHTING BRANCH CIRCUITS TO REMAIN.
- CONTRACTOR SHALL CONTACT THE HOSPITAL STAFF FOR ANY ITEMS THAT THEY MAY WISH TO SALVAGE.

B. WIRING DEVICES:

- REMOVE ALL WIRING DEVICES INCLUDING BUT NOT LIMITED TO LIGHTING SWITCHES, DIMMERS, RECEPTACLES, POWER STRIPS, ETC.
- REMOVE ALL OUTLET BOXES AND COVER PLATES.
- SURVEY, TRACE, IDENTIFY AND REMOVE ALL BRANCH WIRING INCLUDING BUT NOT LIMITED TO CONDUCTORS, CONDUIT, OUTLET BOXES, JUNCTION AND PULL BOXES, SUPPORTS, ETC.
- PROVIDE TEMPORARY POWER AND REFEED EXISTING LIGHTING BRANCH CIRCUITS TO REMAIN.
- CONTRACTOR SHALL CONTACT THE HOSPITAL STAFF FOR ANY ITEMS THAT THEY MAY WISH TO SALVAGE.

NOTES

1. FOR ELECTRICAL GENERAL NOTES, SYMBOL LIST AND ABBREVIATIONS, REFER TO DRAWINGS E-001.00 AND E-002.00.

GENERAL DEMOLITION NOTES

1. PROVIDE ALL LABOR, EQUIPMENT AND MATERIALS AS REQUIRED FOR THE SELECTED DEMOLITION AND REMOVAL OF THE ELECTRICAL EQUIPMENT SHOWN IN DRAWINGS.
2. FIELD CHECK THE EXISTING CONDITIONS WHERE WORK IS TO BE DONE TO DETERMINE THE EXTENT OF THE DEMOLITION WORK. ALL DEMOLITION WORK IN THE EXISTING BUILDING SHALL BE DONE WHEN AND AS DIRECTED BY THE OWNER/ARCHITECT. ALL NECESSARY OVERTIME TO ACCOMPLISH THE DEMOLITION WORK IN THE EXISTING BUILDING SHALL BE INCLUDED HEREIN.
3. THE CONTRACTOR SHALL CIRCUIT TRACE THE EXISTING WIRING INSTALLATION AS REQUIRED TO ACCOMMODATE THE NEW WORK AND DEMOLITION WORK OF THIS CONTRACT.
4. FURNISH AND INSTALL ALL TEMPORARY CONDUIT, WIRE, BOXES, PANELS, ETC. AS REQUIRED TO MAINTAIN ELECTRIC LIGHT AND POWER SERVICE FOR THE EXISTING SPACE OR BUILDING WITH A MINIMUM OF INTERRUPTION AS HEREIN SPECIFIED.
5. AT ALL LOCATIONS, WHERE THE PRESENT ELECTRICAL WORK DUE TO THE ALTERATIONS OR ADDITIONS WILL HAVE TO BE MODIFIED OR CHANGED, THIS CONTRACTOR SHALL PROVIDE ALL THE NECESSARY TEMPORARY WIRING TO MAINTAIN CONTINUOUS ELECTRICAL SERVICE TO ROOMS WITHIN OR BEYOND THE DISTURBED AREAS.
6. CONTRACTOR SHALL FURNISH AND INSTALL ALL NEW CONDUITS, WIRE, BOXES, CIRCUIT BREAKERS, FUSED DISCONNECTS, ETC., AS REQUIRED AND SHALL RECONNECT ALL EXISTING OUTLETS TO REMAIN. ALL DISTURBED ELECTRICAL WORK TO REMAIN, AFTER REMOVAL OF PARTITIONS, CEILINGS, ETC., SHALL BE REROUTED AND RECONNECTED WITH ALL NEW CONDUITS, WIRE, BOXES, OUTLETS, ETC., AS REQUIRED. ALL EXISTING WORK TO REMAIN SHALL BE LEFT IN COMPLETE OPERATING CONDITION.
7. DISCONNECT, REMOVE, RELOCATE AND RECONNECT ANY ELECTRICAL EQUIPMENT NOT SHOWN ON THESE DRAWINGS AS PART OF THIS CONTRACT, BUT INTERFERES WITH THE WORK UNDER THIS CONTRACT. THIS WORK SHALL NOT BE CONSIDERED EXTRA AND SHALL BE DONE AT NO ADDITIONAL COST TO THE OWNER..
8. REMOVE ALL ABANDONED OUTLETS COMPLETE WITH WIRING AND CONDUIT.
9. REMOVE ALL ABANDONED WIRING AND CONDUIT. WHEN CONDUIT REMOVAL IS IMPRACTICAL (CONCEALED CONDUIT), CUT BACK AND ABANDON CONDUIT.
10. ALL DEMOLITION, REMOVAL, AND DISPOSAL WORK SHALL BE IN COMPLIANCE WITH THE REQUIREMENTS OF THE BUILDING CODE AND WITH ALL STATE AND FEDERAL REGULATIONS.
11. REMOVE ALL DEBRIS AND REMOVED ELECTRICAL EQUIPMENT AND/OR FIXTURES NOT EXPLICITLY DESIGNATED TO BE SALVAGED (TO REMAIN) FROM THE PREMISES AND LEGALLY DISPOSE OFF AWAY FROM PREMISES AS DIRECTED BY THE BUILDING OWNER.
12. ITEMS INDICATED TO BE SALVAGED SHALL BE REMOVED EITHER BEFORE DEMOLITION OR DURING THE PROCESS OF THE WORK, STORED, PROTECTED AND CLEANED PRIOR TO REINSTALLATION OR PRIOR TO BE RETURNED TO THE OWNER REPRESENTATIVE.
13. PROTECT MATERIALS, SURFACES AND STRUCTURE, WHICH ARE TO REMAIN, FROM DAMAGE; IF DAMAGE OCCURS, REPAIR OR REPLACEMENT SHALL BE MADE BY THE CONTRACTOR, TO THE SATISFACTION OF THE OWNER REPRESENTATIVE, AND AT THE EXPENSE OF THE CONTRACTOR. ALL RESTORATION WORK SHALL RESTORE DISTURBED SURFACES TO ACCURATELY MATCH ALL SURROUNDING CONSTRUCTION USING THE SAME MATERIAL, WORKMANSHIP AND FINISH AS EXISTING SURFACES

THIS PLAN IS APPROVED ONLY FOR WORK INDICATED ON THE APPLICATION SPECIFICATION SHEET. ALL OTHER MATTERS SHOWN ARE NOT TO BE RELIED UPON, OR TO BE CONSIDERED AS EITHER BEING APPROVED OR IN ACCORDANCE WITH APPLICABLE CODES.


PROGRESS
11-02-2011

DOB EMPLOYEE STAMPS AND SIGNATURES:

DOB BSCAN
STICKER:

REVISION DATE REASON FOR ISSUE

KEY PLAN :

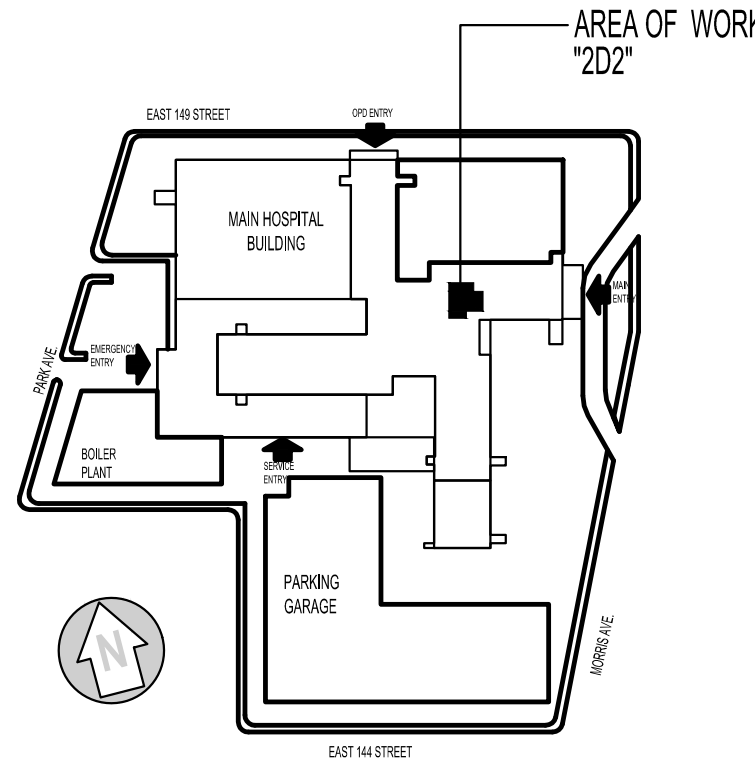

CLIENT:

HHC **NEW YORK CITY
HEALTH AND
HOSPITALS
CORPORATION**

CLIENT:

 **LINCOLN MEDICAL AND
MENTAL HEALTH CENTER** 

ARCHITECT:

M J C L
Architects, PLLC
1416 Avenue M, Brooklyn, NY 11230
Tel.: (718) 339-3390 Fax: (718) 339-3642

ENVIRONMENTAL ENGINEERING CONSULTANT:

Lilker Associates
Consulting Engineers, PC
1001 Avenue of the Americas, New York, NY 10018
tel 212.695.1000 fax 212.695.1299 www.lilker.com

PROJECT:

NEW CLINIC RENOVATION AT SECOND FLOOR

DRAWING:

**SECOND FLOOR
LIGHTING DEMOLITION PLAN**

SCALE: 1/4" = 1'-0"

DRAWN BY: CP

CHECKED BY: GA

DATE: 09-06-2011

JOB #: 21115.00

DRAWING #:

E-011.00